



- ☐ Model 962 — Recess-Mounted **Bradex**®
- ☐ Model 962-11 — Surface-Mounted **Bradex**®

- ☒ Meets relevant sections of the CPSIA to the extent possible.
- ☒ Meets or exceeds ASTM F2285 Safety Specification for Commercial Changing Stations.

Product Materials

Body: bacterial-resistant polyethylene with brushed 20 gauge stainless steel exterior. Rated to support static load of 250 lbs, tested to 390 lbs. Pneumatic gas shock mechanism to ensure smooth, safe open and close motions.

Corner Guards: Black nylon 6/6 corner guards for added protection.

Handle: Black ABS plastic handle.

Molded Dual Liner Dispenser: holds approx. 50 per dispenser (liners sold separately).

Safety Belt: with cam-buckle, adjustable with one hand.

WARNING: Be sure to use reinforced backing behind wall where mounting screws or anchoring devices are installed to ensure adequate support for the baby changing station. All anchoring devices (supplied by installer) must be appropriate for specific wall construction. Severe personal injury and/or property damage may result from improper mounting.

Product Compliance

Complies with


- ADA



- ☒ Serves the American Disabilities Act when installed according to these requirements.

Orders composed of products indicated as **Bradex**® will be available to ship in three days after receipt of order at the factory. There is no pricing penalty for this service from Bradley.

Verify all rough-in dimensions prior to installation. Consult local and national codes. Conformity and compliance to local and national codes is the responsibility of the installer.

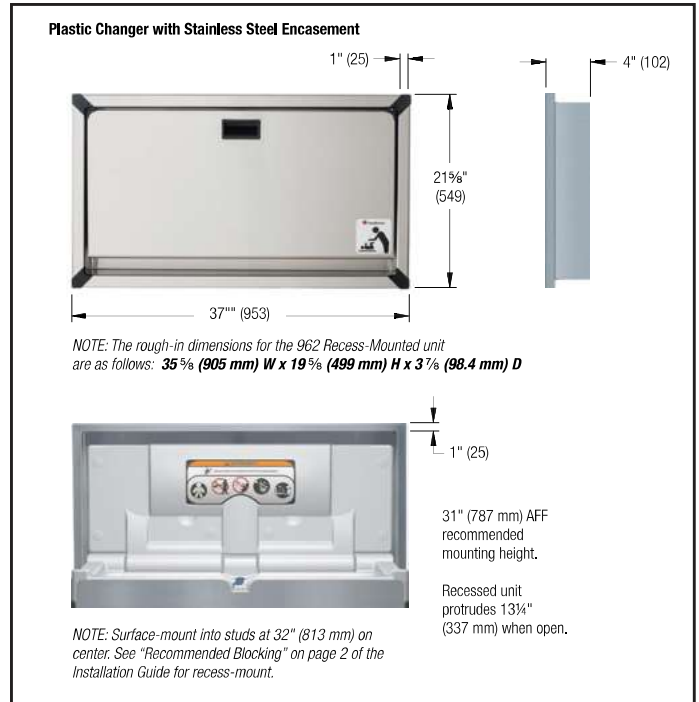

Service Parts Available

Part Number	Description
☐ P11-021	Liners (100% bio-degradable), Case of 500
☐ P15-491	Replacement Strap